

TYPICAL SS-4035E INSTALLATION

- 1) Window must be installed level and square to work properly.
- 2) Anchor per Florida Bldg. codes anchor schedule.
- 3) 115V/15 Amp. Dedicated circuit require
- 4) Recommended height from floor to service opening to be 36".
(Check any and all local or city codes)
- 5) Silicone all exterior and interior joints.
- 6) All other type of anchoring to be approved by certified engineer.

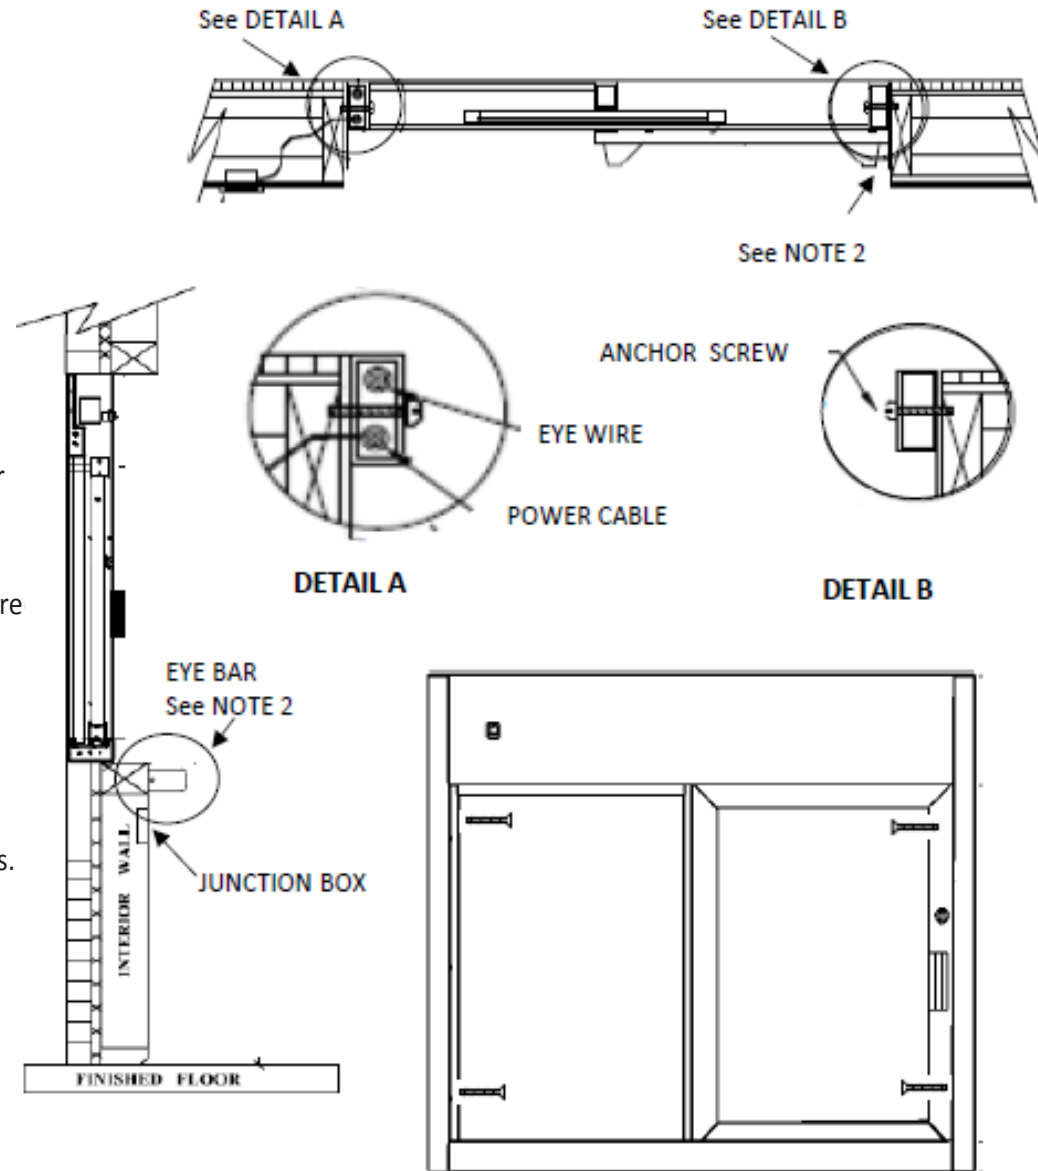


FIGURE 1

General Notes

Actual Dimension
48"(W) x 41"(H)

Service Opening
20-3/4"(W) x 29"(H)

Rough Opening
48-3/8"(W) x 41-3/8"(H)

NOTE 1:
Anchor Screws to be supplied by contractor.

NOTE 2:
Eye set to be mounted in the middle of the service opening. The outside edge should be in line with the outer edge of the side jamb of the operating door.

NOTE 3:
The junction box for power supply to be supplied by contractor.

CAUTION:
Use caution when drilling. The power supply cable is located in the left hand jamb.



COVENANT
Security Equipment

www.covenantsecurityequipment.com

NOTE: THIS DRAWING EMBODIES A CONFIDENTIAL PROPRIETY DESIGN ORIGINATED AND OWNED BY COVENANT SECURITY EQUIPMENT, AND IS SUBMITTED UNDER A CONFIDENTIAL RELATIONS ALL PATENT, MANUFACTURING, SALE RIGHTS REGARDING THE SAME ARE RESERVED EXCEPT TO THE EXTENT RIGHTS ARE EXPRESSLY GRANTED TO OTHERS. THE RECIPIENT AGREES BY ACCEPTING HIP. THESE DRAWINGS NOT TO SUPPLY OR DISCLOSE ANY INFORMATION REGARDING THEM TO ANY UNAUTHORIZED PERSON.

TITLE: INSTALLATION PROCEDURE				
Drawing Name: SS-4035E INSTALLATION DRAWING				
DATE 4/04/2016	DRAWN BY RBV	SCALE NTS	SHEET 1 of 1	SIZE A